

---

### Addendum No. 1

**Project:** Tennis Court Replacements  
**Client:** Hilliard City Schools  
**Issued:** 2.4.2026

*This addendum amends the drawings and specifications and shall be accounted for in preparing your proposal. This addendum is a part of the Contract Documents and must be acknowledged on the bid form.*


**ITEM 1 C4.0 Sheets:** Dimensions have been added to the saw cuts.


**ITEM 2 Specifications: Section 116500 – Athletic Equipment:** Tennis Net Tension Gauge has been removed from Section 1.2.A.2.

#### Attachments:

1. C4.0 – Darby HS Location Plan
2. C4.0 – Davidson HS Location Plan
3. Specification Section 116500 – Athletic Equipment

**End of Addendum No. 1**

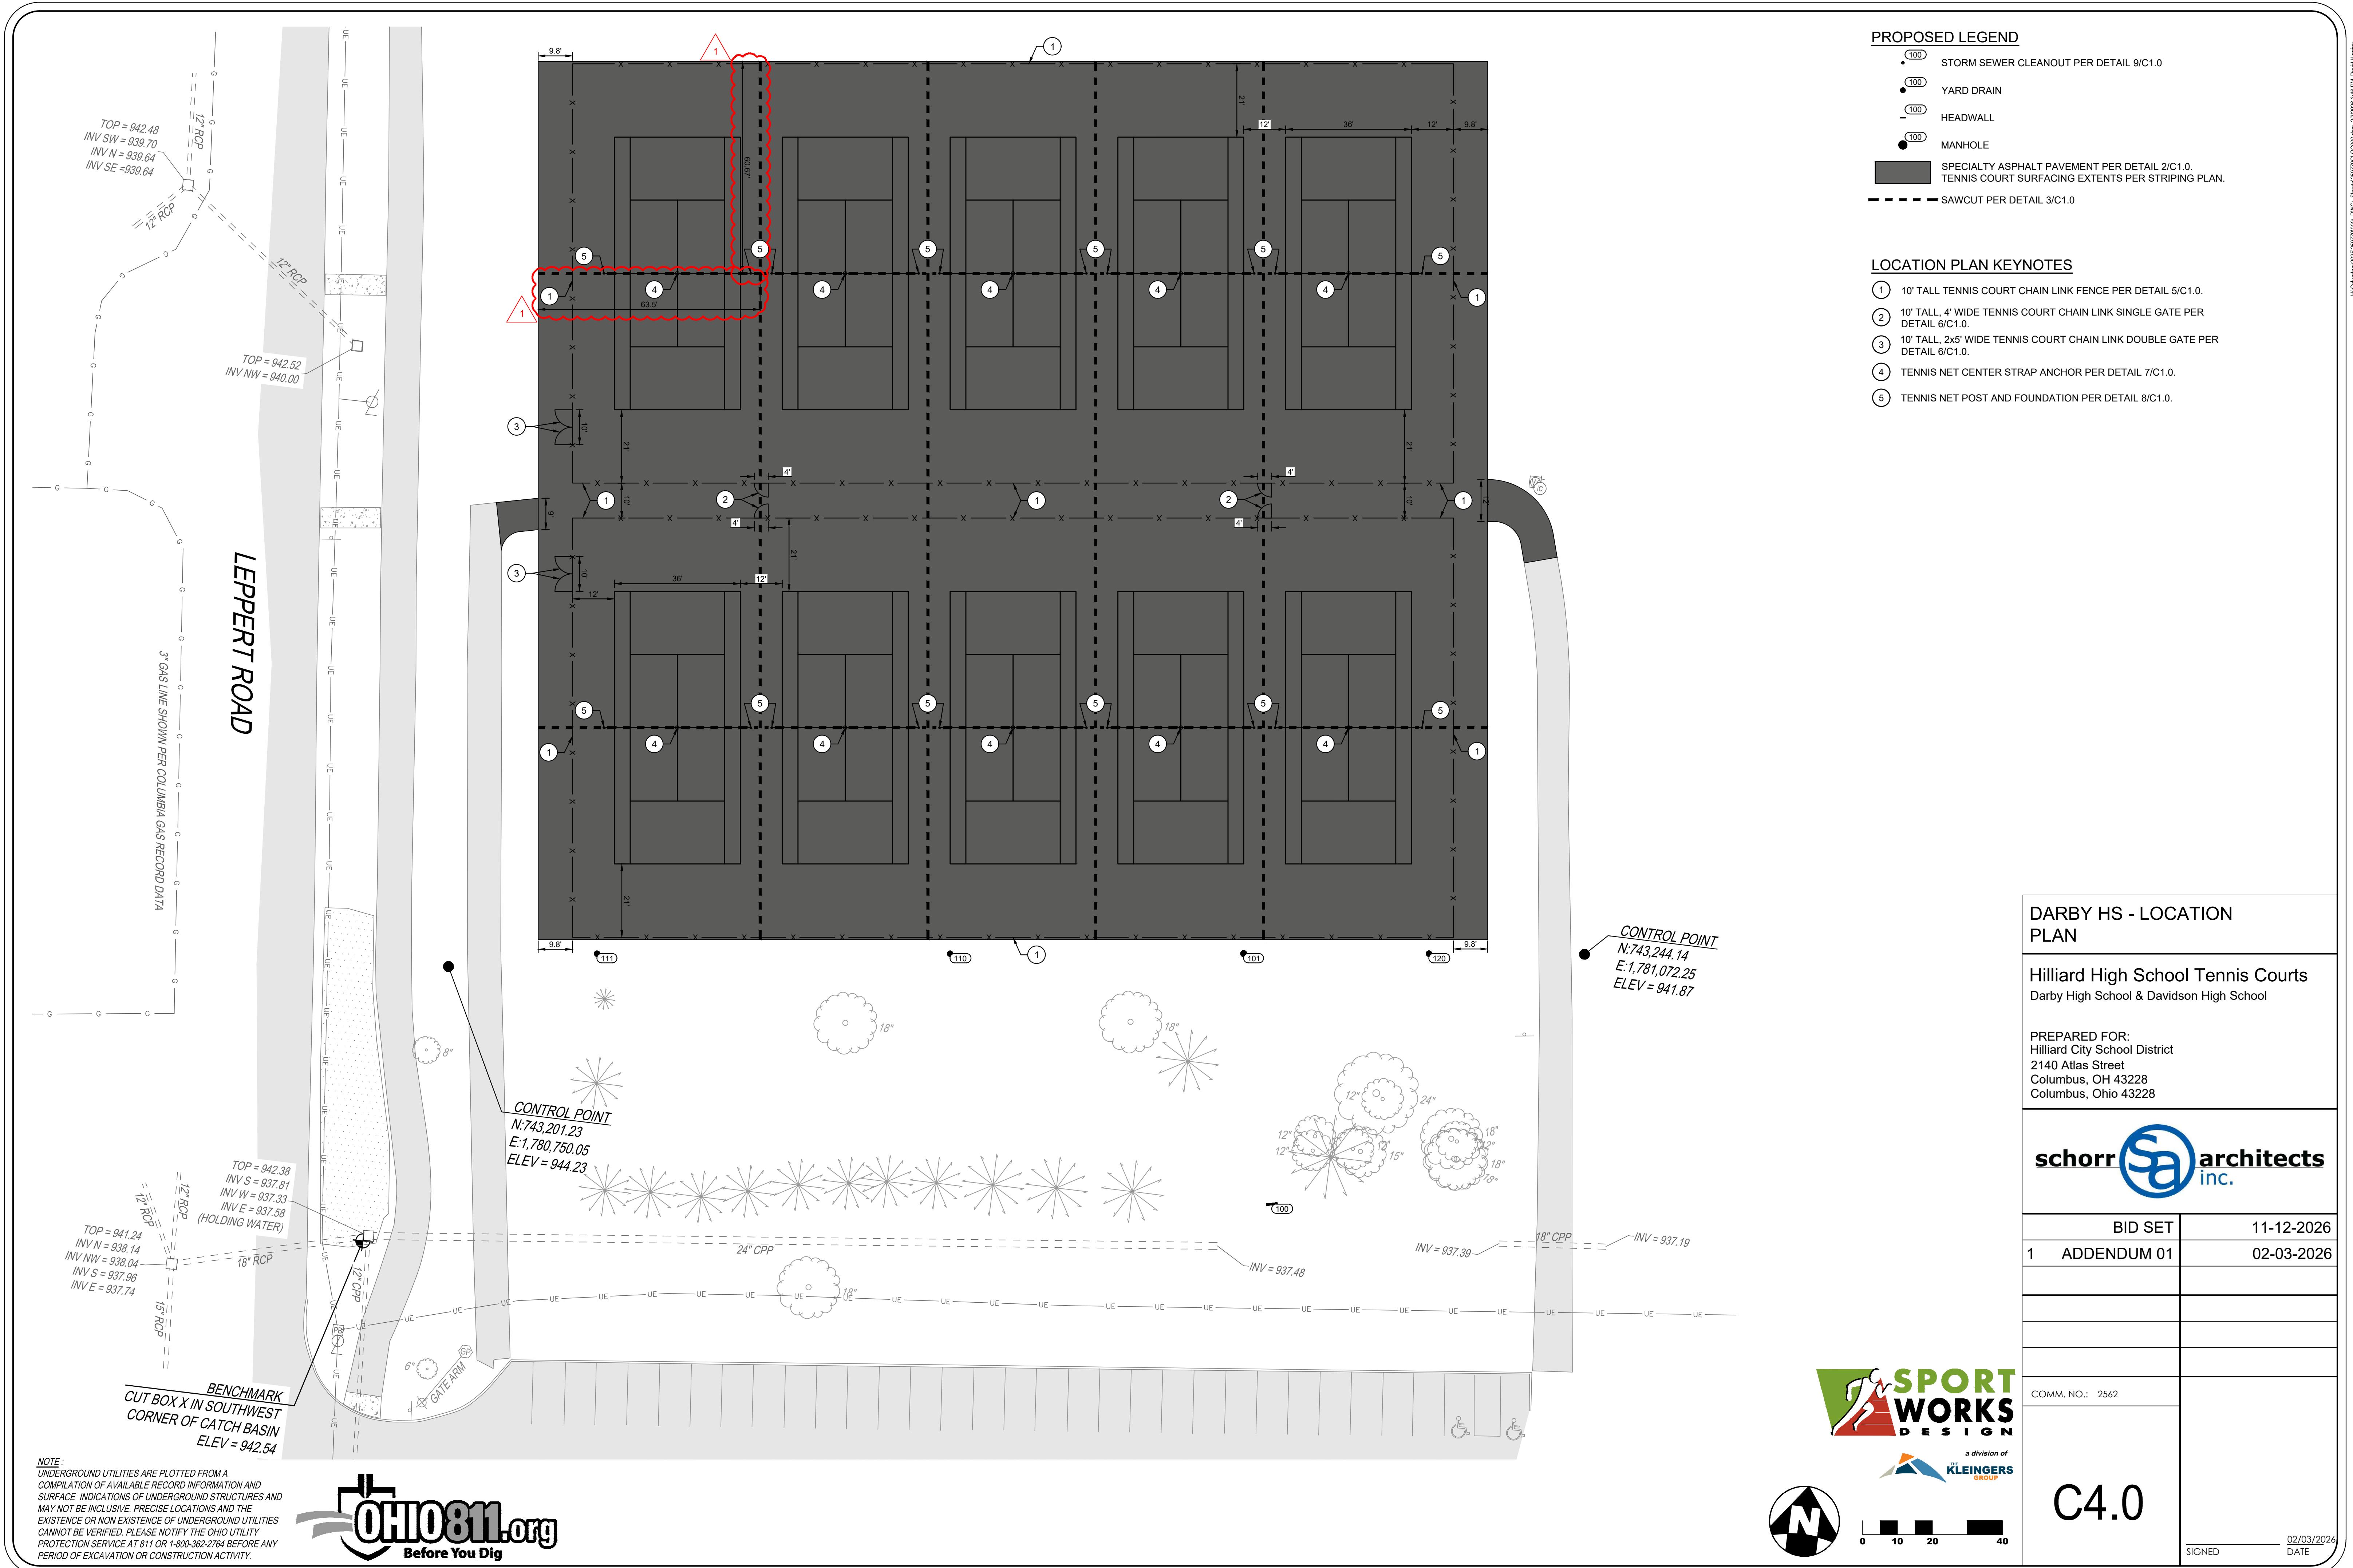

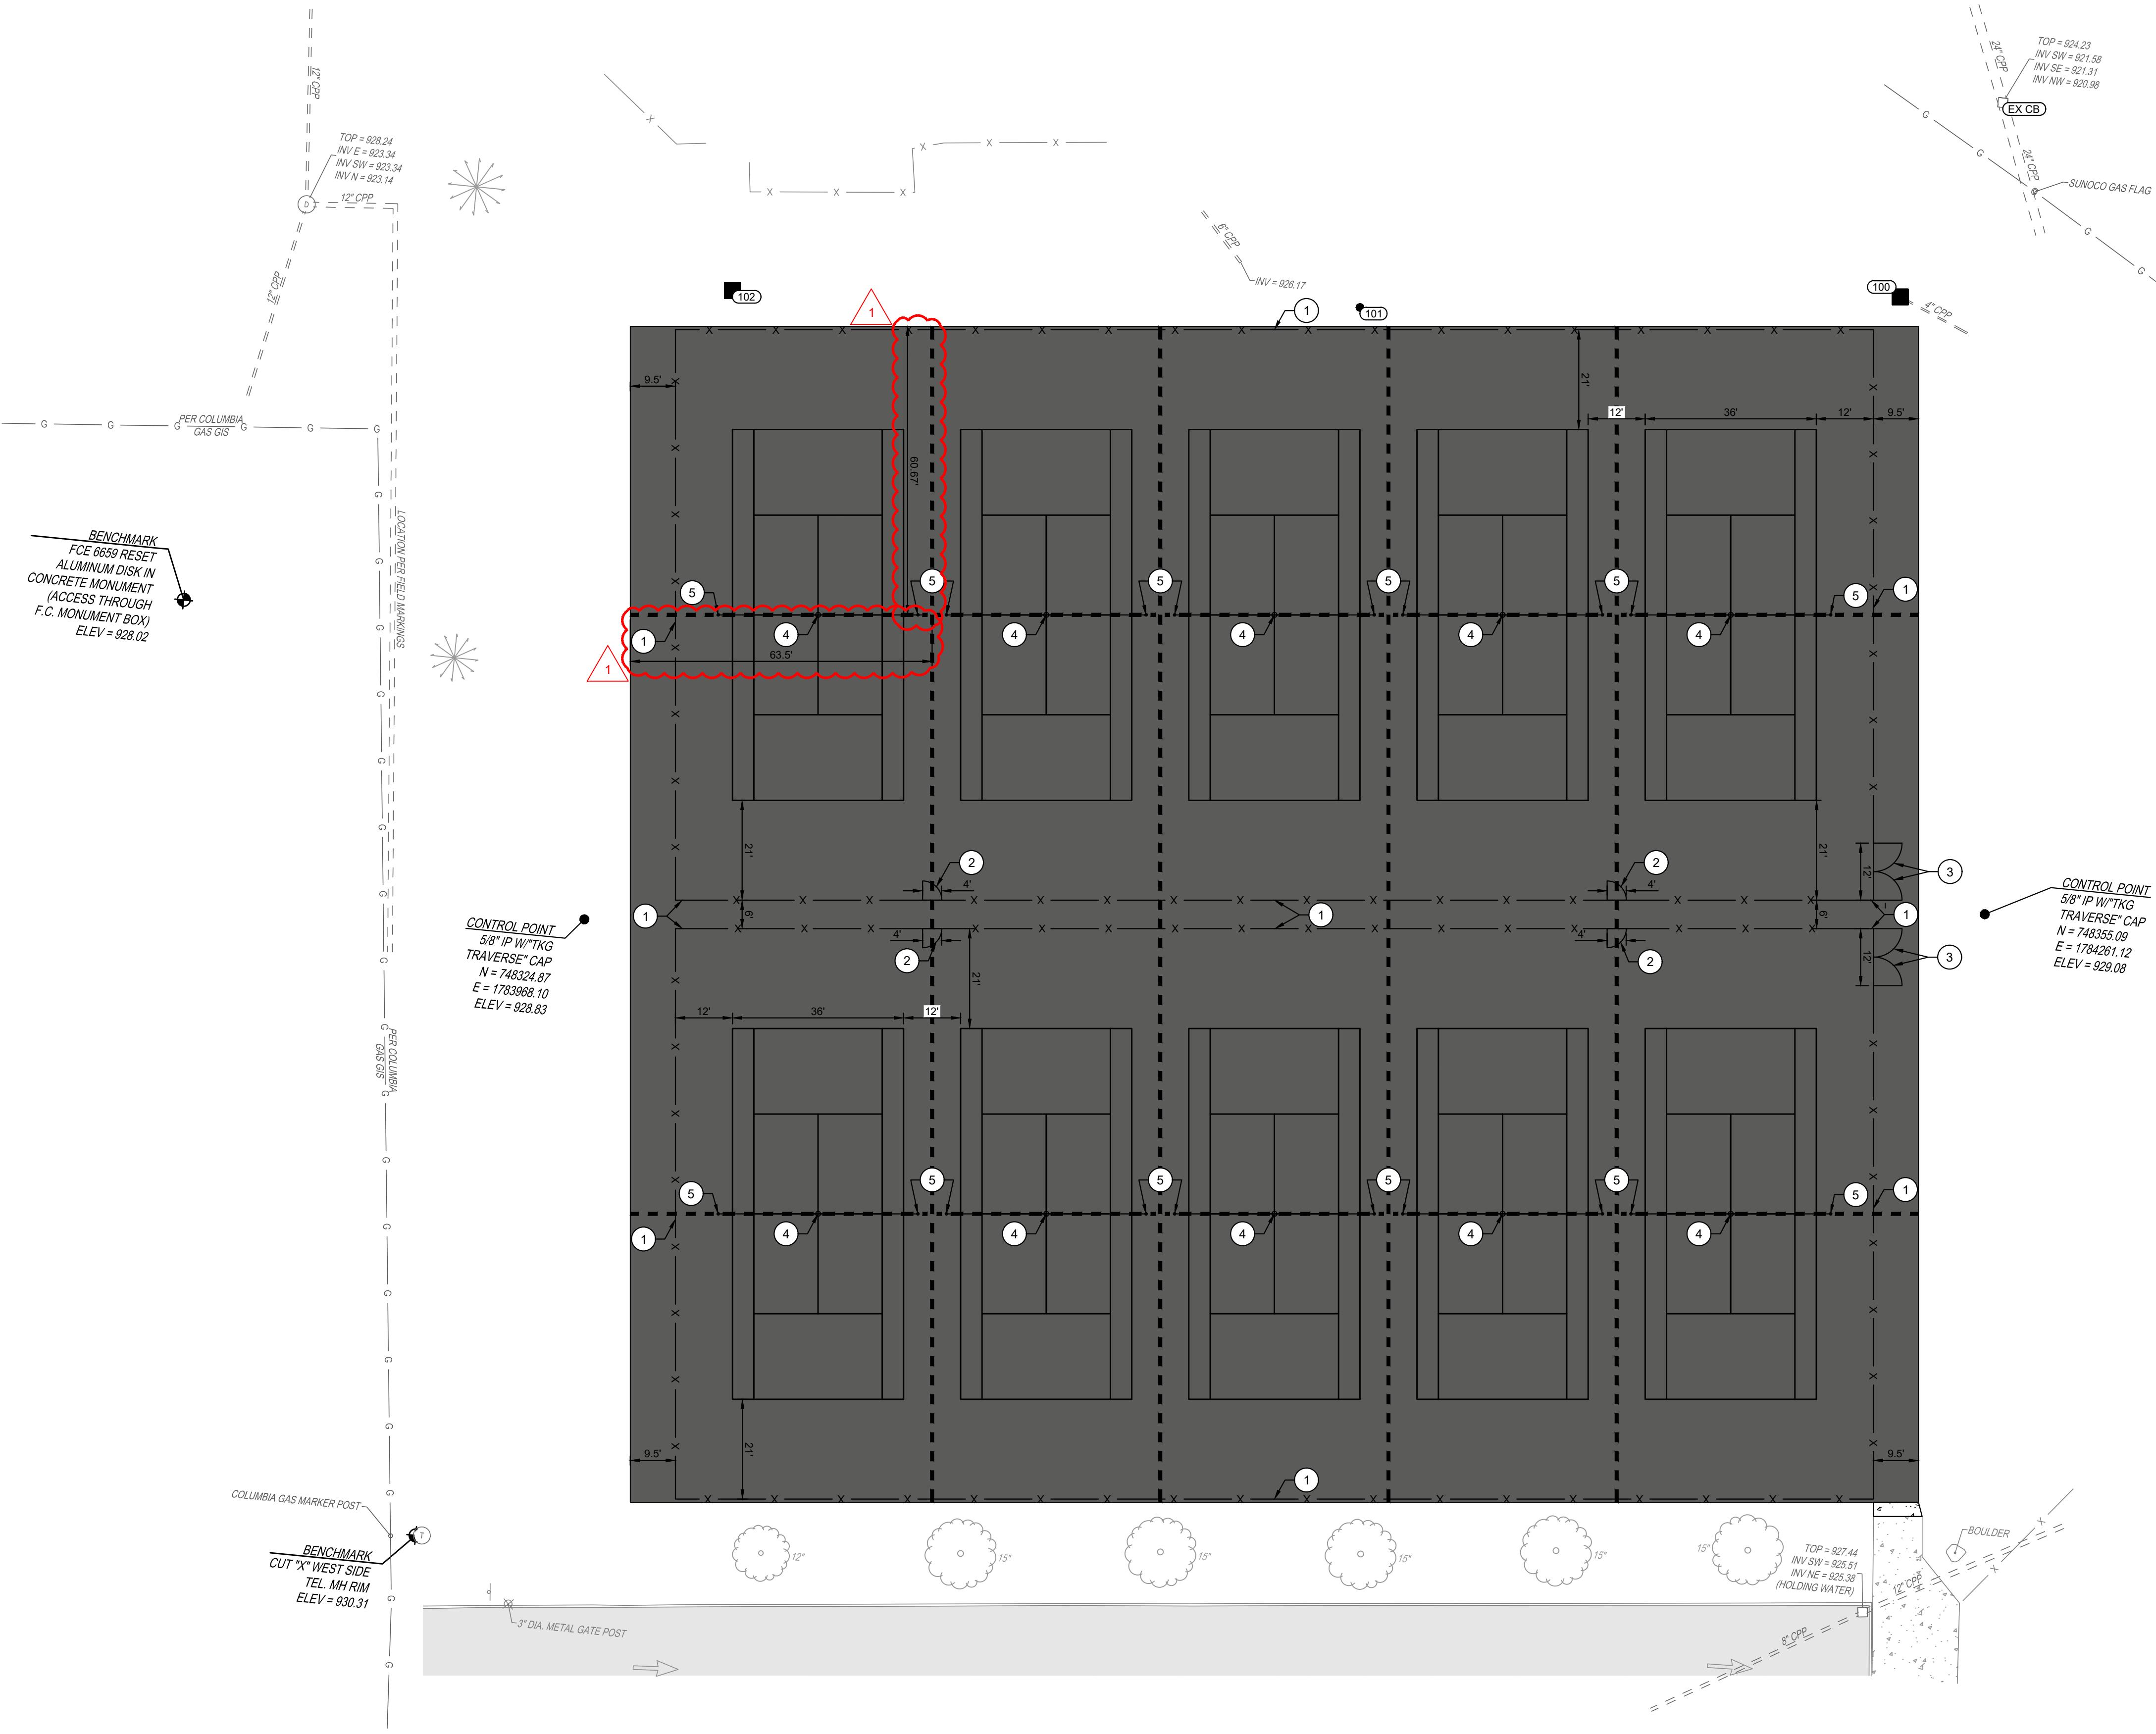

PROPOSED LEGEND	
100	STORM SEWER CLEANOUT PER DETAIL 9/C1.0
100	YARD DRAIN
100	HEADWALL
100	MANHOLE
■	SPECIALTY ASPHALT PAVEMENT PER DETAIL 2/C1.0. TENNIS COURT SURFACING EXTENTS PER STRIPING PLAN.
■	CONCRETE WALK PER DETAIL 1/C1.0
■	SAWCUT PER DETAIL 3/C1.0

#### LOCATION PLAN KEYNOTES

- (1) 10' TALL TENNIS COURT CHAIN LINK FENCE PER DETAIL 5/C1.0.
- (2) 10' TALL, 4' WIDE TENNIS COURT CHAIN LINK SINGLE GATE PER DETAIL 6/C1.0.
- (3) 10' TALL, 2x6' WIDE TENNIS COURT CHAIN LINK DOUBLE GATE PER DETAIL 6/C1.0.
- (4) TENNIS NET CENTER STRAP ANCHOR PER DETAIL 7/C1.0.
- (5) TENNIS NET POST AND FOUNDATION PER DETAIL 8/C1.0.

#### DAVIDSON HS - LOCATION PLAN


Hilliard High School Tennis Courts  
Darby High School & Davidson High School

PREPARED FOR:  
Hilliard City School District  
2140 Atlas Street  
Columbus, OH 43228  
Columbus, Ohio 43228

**schorr**  **architects**  
inc.

BID SET	11-12-2026
1 ADDENDUM 01	02-03-2026

COMM. NO.: 2562

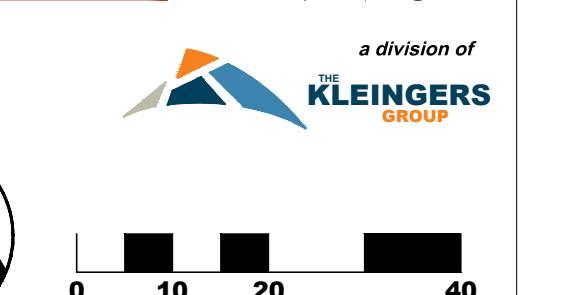

C4.0

02/03/2026  
DATE

NOTE:  
UNDERGROUND UTILITIES ARE PLOTTED FROM A  
COMPILATION OF AVAILABLE RECORD INFORMATION AND  
SURFACE INDICATIONS OF UNDERGROUND STRUCTURES AND  
MAY NOT BE INCLUSIVE. PRECISE LOCATIONS AND THE  
EXISTENCE OR NON EXISTENCE OF UNDERGROUND UTILITIES  
CANNOT BE VERIFIED. PLEASE NOTIFY THE OHIO UTILITY  
PROTECTION SERVICE AT 811 OR 1-800-362-7264 BEFORE ANY  
PERIOD OF EXCAVATION OR CONSTRUCTION ACTIVITY.



## **SECTION 116500 – ATHLETIC & RECREATIONAL EQUIPMENT**

### **PART 1 - GENERAL**

#### **1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### **1.2 SUMMARY**

- A. This Section includes the following outdoor tennis, track and field equipment:

1. Tennis Court Net
2. ~~Tennis Net Tension Gauge~~ **REMOVED (ADDENDUM 1)**
3. Tennis Court Net Post
4. Tennis Court Net Post Ground Sleeve
5. Tennis Court Center Strap and Anchor

- B. Related Sections include the following:

1. Division 03 Section “Cast In Place Concrete” for criteria for structural concrete bases for sport equipment.
2. Division 32 Section “Chain Link Fences and Gates” and “Decorative Metal Fences and Gates” for fences at sport fields.
3. Division 32 Section “Concrete Paving” for concrete pads and walks associated with sport fields.

#### **1.3 DEFINITIONS**

- A. NFHS: The National Federation of State High School Associations.

#### **1.4 SUBMITTALS**

- A. Product Data: For each type of product indicated.
1. If applicable, include assembly, disassembly, and storage instructions for removable equipment.
- B. Structural analysis data signed and sealed by the qualified professional engineer responsible for their preparation including loads, footing and foundation design for football goal posts.
- C. Coordination Drawings: Layout plans, drawn to scale, and coordinating locations of all field equipment and space requirements.
- D. Samples for Initial Selection: For each type of equipment offering a color selection.
- E. Samples for Verification:

1. Actual material sample of material in color(s) selected. Provide sample that is approximately 8-inches square or (for extrusions and linear items) 12-inches long.
- F. Product Certificates: For each type of equipment, signed by product manufacturer.
- G. Qualification Data: For installer.
- H. Operation and Maintenance Data: For equipment to include in operation and maintenance manuals.
- I. Warranty: Special warranty specified in this Section.

#### 1.5 QUALITY ASSURANCE

- A. Source Limitations: Obtain each type of equipment through one source from a single manufacturer.
- B. Conform to the latest rules and regulations of the NFHS.

#### 1.6 PROJECT CONDITIONS

- A. Field Measurements: Verify position and elevation of equipment. Coordinate fully with finish grading elevations and finish paving elevations.
- B. Install only when other site work is completed to a point that ensures no displacement of installed athletic field equipment.
- C. Install equipment only when weather conditions and soil conditions are in a range acceptable to the equipment manufacturer.

#### 1.7 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace components of field sport equipment that fail in materials or workmanship within specified warranty period.
  1. Warranty Period: Five years from date of Substantial Completion.

### PART 2 - PRODUCTS

#### 2.1 MATERIALS

- A. Aluminum: Alloy and temper recommended by manufacturer for type of use and finish indicated.
  1. Extruded Bars, Profiles, and Tubes: ASTM B 221.
  2. Cast Aluminum: ASTM B 179.
  3. Flat Sheet: ASTM B 209.
- B. Steel: Comply with the following:
  1. Steel Plates, Shapes, and Bars: ASTM A 36.

2. Steel Tubing: ASTM A 500 or ASTM A 513, cold formed.
3. Steel Sheet: ASTM A 1011.
4. Stainless Steel Sheet, Strip, Plate, and Flat Bar: ASTM A 666.
5. Stainless Steel Bars and Shapes: ASTM A 276

C. Anchors, Fasteners, Fittings and Hardware: Manufacturer's standard corrosion-resistant or noncorrodible units; concealed.

D. Grout: Nonshrink, nonmetallic, premixed, factory-packaged, nonstaining, noncorrosive, nongaseous grout complying with ASTM C 1107 with minimum strength recommended in writing by equipment manufacturer.

## 2.2 SPORTS EQUIPMENT

A. Basis-of-Design Product: Subject to compliance with requirements, provide the product indicated as the basis of design or the most comparable product by one of the other named manufacturers. If product number given for the "other named" manufacturers is not the closest possible to the basis of design, advise Architect and submit the product that IS most close to the basis of design.

B. Tennis Court Net:

1. 42 feet by 42" wide - 3mm braided black polyethylene.
2. Quadruple stitched heavy-duty polyester web headband with 3/16" dia vinyl coated steel cable.
3. Top five rows are double mesh.
4. Includes synthetic taped bottom edges and grommeted side pockets with dowels.
5. 5 year warranty.
6. Color: per owner's preference.
7. Products:
  - a. Basis of Design: Jaypro #TTN-3
  - b. Douglas TN-30DM
  - c. Edwards

C. Tennis Court Net Post:

1. 3" Round post installed with ground sleeve and removable winch handle.
2. 11 gauge steel posts, powder coated.
3. Welded lacing rods for securing net to the post.
4. Color: per owner's preference.
5. Products:
  - a. Basis of Design: Jaypro #RTP-300
  - b. Sportsfield Specialties Model # TSEG
  - c. Douglas Premier RD
  - d. Edwards

D. Tennis Court Net Post Ground Sleeve:

1. 3" dia ground sleeve to match tennis court net post.
2. Galvanized steel 24" long.
3. Products:
  - a. Basis of Design: Jaypro #RTPGS-3
  - b. Douglas
  - c. Edwards

E. Tennis & Center Strap and Anchor:

1. 2" Wide adjustable nylon webbing with double snap hook.

2. All-aluminum anchor with stainless steel drive pin for easy snap assembly.

3. Products:

- a. Basis of Design: Jaypro #CS-1 and A-2
- b. Douglas
- c. Edwards

F. Tennis Court Hitting Wall:

1. 10' High X 20' Wide.

2. Wall to be entirely flat against the baseline fence.

3. Material to be fiberglass or polyethylene only.

4. Products:

- a. Basis of Design: Douglas Bakko Fiberglass, Professional Flat Series
- b. Rally Master Backboard #RM10x20
- c. JW Industries #TBB-10-24

### **PART 3 - EXECUTION**

#### **3.1 EXAMINATION**

A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for position, elevation and alignment of mounting substrates, installation tolerances, operational clearances and other conditions affecting performance.

1. Verify critical dimensions.

2. Examine supporting structure and subgrades, and footings.

3. Proceed with installation only after unsatisfactory conditions have been corrected.

#### **3.2 INSTALLATION, GENERAL**

A. General: Comply with manufacturer's written installation instructions and competition rules applicable to each type of equipment. Complete equipment field assembly, where required.

B. Unless otherwise indicated, install equipment after interfacing final grades and paving have been completed.

C. Permanently Placed Equipment and Components: Rigid, level, plumb, square, and true; anchored securely to supporting structure; positioned at locations and elevations indicated on Shop Drawings; in proper relation to adjacent construction; and aligned with filed sport layout.

D. Insert Setting: Position sleeve in oversized, recessed voids in concrete and footings. Clean voids of debris. Fill void around sleeves with grout, mixed and placed to comply with grout manufacturer's written instructions.

E. Anchoring to In-Place Construction: Use anchors and fasteners where necessary for securing built-in and permanently placed equipment to structural support and for properly transferring load to in-place construction.

- A. Skinned Infield: See Drawings for elevations. Grade to  $\frac{1}{4}$  inch variation in 10 feet for flat, sloped, or curved profiles.
  1. The subgrade shall be prepared at a uniform depth of 6 inches below the finished grade.
  2. The subgrade shall then be rolled with a 3 to 5 ton roller, or other suitable roller, and the surface lightly scarified to insure bonding with the sand clay mixture.
  3. If placing a pre-packaged infield mix, spread evenly to a loose depth so that the compacted depth will be 6 inches.
  4. If preparing a field-mixed infield mix:
    - a. Evenly spread a layer of clay on the prepared subgrade and thereon a layer of sand to such a loose depth that, when compacted, the material mixed together shall be the required 6 inch depth. The order of spreading the sand and clay may be reversed if required by the Architect.
    - b. These 2 layers shall then be thoroughly mixed and pulverized in place and spread by a minimum of 6 passes by a roto tiller or other approved mechanical means, shaped, and compacted to a uniform depth and approved by the Architect. If the moisture content is such as not to permit satisfactory compaction, water shall be added under his direction.
  5. Apply "soil conditioner" at the rate of eight 50 lb bags per 100 sq ft., equal to 12-1/2 sq ft per bag, each bag at the center of a square measuring 42-1/2 inches on each side. After emptying the bags, level the piles of "soil conditioner" with rakes or tractor grading blade to a uniform thickness. By use of a rototiller, disc cultivator, tiller rake, or tine harrow, thoroughly mix "soil conditioner" in an evenly blended layer in the top 3 inches. The preferred implement is a tractor mounted rototiller. A half ton or one ton power roller will compact the loose mixture to the required firmness.
- B. Install protective pads in strict accordance with manufacturer's recommendations and as located on the plans.

#### 3.4      ADJUSTING

- A. Adjust components to operate safely, smoothly, easily, and quietly, free from binding, warp, distortion, nonalignment, misplacement, disruption, or malfunction, throughout entire operational range. Lubricate hardware and moving parts.

#### 3.5      CLEANING

- A. After completing equipment installation, inspect components. Remove spots, dirt, and debris and touch up damaged shop-applied finishes according to manufacturer's written instructions.
- B. Replace equipment and finishes that cannot be cleaned and repaired, in a manner approved by the Architect, before time of Substantial Completion.

#### 3.6      DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain equipment.

**END OF SECTION 116500**